

Shear Strength Evaluation of the Segmental Retaining Wall Unit “Murata”



Project No. 18-110-3
July 21, 2020

CONDUCTED FOR:
Western Interlock Inc.
10095 Rickreall Rd.
Rickreall, Oregon 97371

CONDUCTED BY:

NATIONAL
CONCRETE MASONRY
ASSOCIATION

NCMA
LAB

RESEARCH & DEVELOPMENT

IAS

INTERNATIONAL
ACCREDITATION
SERVICE®

RESEARCH AND DEVELOPMENT LABORATORY

The NCMA Research and Development Laboratory is devoted to the scientific research and testing of concrete masonry products and systems. The Laboratory is staffed by professional engineers and technicians with many years of experience in the concrete masonry industry. The Laboratory is equipped to perform nearly any physical research or testing of concrete masonry units and assemblages. The Laboratory performs research and development work for both the Association and individual companies.

NATIONAL CONCRETE MASONRY ASSOCIATION

The National Concrete Masonry Association (NCMA) is a non-profit organization whose mission is to support and advance the common interests of its members in the manufacture, marketing, research, and application of concrete masonry products. The Association is an industry leader in providing technical assistance and education, marketing, research and development, and product and system innovation to its members and to the industry.

Research and Development Laboratory Staff

Douglas H. Ross, *Manager, Research and Development Laboratory*

Timothy Jones, *Senior Laboratory Technician*

Carrie Lutz, *Materials Research Assistant*

Stanley Smith, *Laboratory Technician*

NCMA Technical Staff

Jason J. Thompson, *Vice President of Engineering*

Brian Roye, *Engineering Projects Manager, Structural*

Monika Nain, *Structural Hardscapes Manager*

National Concrete Masonry Association

Research and Development Laboratory

13750 Sunrise Valley Drive

Herndon, Virginia 20171

(703) 713-1900

www.ncma.org

THIS PUBLICATION IS INTENDED FOR USE BY PROFESSIONAL PERSONNEL COMPETENT TO EVALUATE THE SIGNIFICANCE AND LIMITATIONS OF THE INFORMATION PROVIDED HEREIN, AND WILLING TO ACCEPT TOTAL RESPONSIBILITY FOR THE APPLICATION OF THIS INFORMATION IN SPECIFIC INSTANCES. RESULTS FROM TESTS MAY VARY AND THE NATIONAL CONCRETE MASONRY ASSOCIATION (NCMA) DOES NOT WARRANT THE RESULTS CONTAINED HEREIN FOR SPECIFIC USES OR PURPOSES AND THE FINDINGS ARE NOT A SUBSTITUTE FOR SOUND ENGINEERING EVALUATIONS, JUDGMENT AND OPINIONS FOR SPECIFIC PROJECTS OR USES. THE NCMA IS NOT RESPONSIBLE FOR THE USE OR APPLICATION OF THE INFORMATION CONTAINED IN THIS PUBLICATION AND DISCLAIMS ALL RESPONSIBILITY THEREFORE

The measured and calculated values provided in this report are the official values resulting from this body of work. Values in parenthesis are mathematical conversions provided for reference only and may differ slightly from the official values due to conversion rounding.

This report was prepared for Western Interlock Inc., by the National Concrete Masonry Association Research and Development Laboratory based upon testing, analyses, or observations performed by the National Concrete Masonry Association Research and Development Laboratory. Reference herein to any specific commercial product, process, or service by trade name, trademark, or manufacturer does not necessarily constitute or imply its endorsement or recommendation by the National Concrete Masonry Association or its staff. The contents of this report have been reviewed by the following individuals, who believe to the best of their ability that the observations, results, and conclusions presented in this report are an accurate and true representation of the services provided.

The NCMA Research and Development Laboratory is accredited in accordance with the recognized International Standard ISO/IEC 17025:2017. This accreditation demonstrates technical competence for a defined scope and the operation of a laboratory quality management system (refer to the joint ISO-ILAC-IAF Communiqué dated April 2017). All test results presented here are within the scope of accreditation for the NCMA Research and Development Laboratory.


The gradation of aggregate was provided by the client. It is not evaluated by the NCMA Research and Development Laboratory.



7/21/2020

Monika Nain, Engineering Projects Manager- Structural Hardscapes

Date



7/21/2020

Doug H. Ross, Manager, Research and Development Laboratory

Date



7/21/2020

Jason J. Thompson, Vice President of Engineering

Date

This report shall not be reproduced, except in full, without the written authorization of the National Concrete Masonry Association Research and Development Laboratory.

Table of Contents

1. INTRODUCTION	5
2. MATERIALS	5
3. SHEAR STRENGTH PROCEDURES.....	6
4. RESULTS	8
5. DISCUSSION.....	9
6. REFERENCES	10
APPENDIX A- “MURATA” UNIT SHEAR STRENGTH.....	11

Shear Strength Evaluation of the Segmental Retaining Wall Unit “Murata”

1. INTRODUCTION

The shear strength of a segmental retaining wall (SRW) unit system is a design component of these systems. This shear strength is determined through testing in accordance with ASTM D6916-06c (2011), *Standard Test Method for Determining the Shear Strength Between Segmental Concrete Units (Modular Concrete Blocks)* (Ref. 1). In this project, the shear strength of “Murata” segmental retaining wall unit was evaluated, the results of which are reported herein.

2. MATERIALS

All SRW units and geosynthetic reinforcement were sampled and provided by the client. The SRW units are dry-cast concrete blocks with the trade name “Murata”. Table 1 provides the representative dimensions of the units determined by the Laboratory as applicable to this testing program.



Figure 1 –“Murata” SRW Unit

Table 1 – Representative “Murata” SRW Unit Physical Properties

Length front of unit, in. (mm)	15.72 (399.28)
Length back of unit, in. (mm)	9.43 (239.52)
Height, in. (mm)	7.91 (200.91)
Width, in. (mm)	11.6 (294.64)
Received weight, lb (kg)	58.78 (26.66)

For shear strength testing, the cells of the units and the spaces between the SRW units were filled with aggregate. The client provided aggregates and requested to perform the shear strength testing with an aggregate moisture content of approximately 12.5 %. The client reported that the aggregate supplied met the gradation targets shown in table 2 (Ref. 2).

Table 2: Aggregate Gradation for Dense-graded Aggregate (Ref. 2)

Sieve Size	Percent Passing (by weight)				
3/4"	–	–	55 - 75	–	90 - 100
1/2"	–	–	–	55 - 75	–
3/8"	–	–	–	–	55 - 75
1/4"	30 - 45	30 - 45	35 - 50	40 - 55	40 - 60
No. 4 ¹	–	–	–	–	–
No. 10	2	2	2	2	2

¹ Report percent passing sieve when no grading requirements are listed

² Of the fraction passing the 1/4 inch sieve, 40 percent to 60 percent shall pass the No. 10 sieve

3. SHEAR STRENGTH PROCEDURES

The shear strength tests were performed in accordance with ASTM D6916-06c (2011). All tests were performed on the same configuration as described below and in the accompanying photographs.

- A bottom course was constructed using “Murata” units. Two SRW units were used for the construction of the bottom course (Figure 2).
- Aggregate was added to the spaces between the units as needed. The aggregate was compacted after placement (Figure 3).
- A third “Murata” unit was placed on top of the lower course of units (Figure 4).
- The spaces between the units in the second course were filled with aggregate. The aggregate was compacted after placement (Figure 5).
- A neoprene pad and steel plate was placed on the top unit. Rollers were placed on top of this plate to facilitate even loading during testing (Figure 6).
- A steel plate was placed on top of the rollers and additional spacers were added to allow for contact with the vertical hydraulic ram and load cell (Figure 7). Two linear displacement potentiometers were attached to the front corners of the top unit to measure the amount of shear displacement during testing.
- The resulting length of the shear interface using this testing configuration was 1.3 ft (0.40 m).



Figure 2 – Bottom Course of SRW Units



Figure 3 – Bottom Course with Compacted Aggregate



Figure 4 – Top SRW unit placed



Figure 5 – Top course with Aggregate



Figure 6 – Neoprene Pads, Loading Plates, and Beam



Figure 7 – Overall Test Setup

Once the test specimen was constructed it was tested using the procedures defined by ASTM D6916-06c (2011):

- Normal load was applied to the test specimen through a hydraulic loading system applied to the steel spacers, plates, and neoprene pad. The magnitude of the normal load was maintained at a constant level and monitored using an electronic load cell and a data acquisition system.
- With the normal load applied, the upper SRW unit was subjected to a horizontal load by displacing the loading arm that contacts the top SRW unit at a rate equal to 5 ± 1 mm/min (0.20 ± 0.04 in./min). The test was continued until either the shear strength significantly decreased or the displacement exceeded the capacity of the testing equipment.
- Horizontal displacement of the upper SRW unit was recorded during testing.

Testing was performed at five unique normal load levels. One normal load was repeated twice, for a total of seven unique shear strength tests.

4. RESULTS

Shear strength is defined as the shear load divided by the length of the shear interface, which for this project is taken equal to the largest length of the top segmental retaining wall unit. The peak shear strength is defined as the highest recorded value of shear strength. ASTM D6916-06c (2011) requires reporting of serviceability shear strength, but the displacement that defines the serviceability strength is not specified. In this project, the service state shear strength is determined based on the criteria outlined in ICC-ES AC276, *Acceptance Criteria for Segmental Retaining Walls*, (Ref. 3), which requires the deformation criterion to either be 0.75 inch (19.0 mm) or a value equal to 2 percent of the block height, whichever is less. The height of these units is 7.91 inch (200.9 mm), and thus would be limited by the 2 percent criteria which is 0.16 inch (4.1 mm).

Results for the shear strength testing are provided in the Appendix and are summarized in Table 3. In addition to the data presented, a plot of connection strength versus displacement as well as connection strength versus normal load is provided in the Appendix.

As required by the test method, one axial load level was tested three times to determine repeatability. The axial load repeated was 728 lb/ft (10.9 kN/m), and the results of those tests were within the general range of repeatability of the test method ($\pm 10\%$ from the mean of the three tests for the peak shear strength). For each test run the system failed by displacement of the upper unit. Figure 8 shows a typical failure seen in this project.

Table 3 – Summary of Shear Strength Tests – “Murata” Unit

Test Number	Average Axial Load lb/ft (kN/m)	Approximate Wall Height based on Axial Load ft (m)	Service State Shear Strength lb/ft (kN/m)	Peak Shear Strength lb/ft (kN/m)
1	360 (5.4)	4.0 (1.22)	492 (7.2)	746 (10.9)
2	728 (10.9)	8.1 (2.46)	954 (13.9)	954 (13.9)
3	540 (8.1)	6.0 (1.83)	854 (12.5)	854 (12.5)
4	728 (10.9)	8.1 (2.46)	931 (13.6)	931 (13.6)
5	908 (13.6)	10.1 (3.07)	1,154 (16.8)	1,169 (17.1)
6	728 (10.9)	8.1 (2.46)	631 (9.2)	977 (14.3)
7	1,088 (16.3)	12.1 (3.68)	1,262 (18.4)	1,262 (18.4)



Figure 8 – Typical Failure Mode

5. DISCUSSION

The following discussion is not a required portion of the ASTM D6916-06c (2011) standard, but is provided for the reference and convenience of the reader.

A plot of normal load versus shear strength is also provided in the appendix. Using best-fit linear trend lines, relationships are determined in accordance with the NCMA *Design Manual for Segmental Retaining Walls* (Ref. 4). The third edition of this design manual does not include provisions for the serviceability shear strength. While ASTM D6916-06c (2011) requires that serviceability shear strength be determined, it does not define the specified displacement, leaving this displacement to be prescribed by the user. Relationships are provided for both the peak shear strength (V_u) as well as the service state shear strength (V'_u) within the range of normal load tested in this study.

These relationships apply to the combination of SRW units and aggregate used in this study.

6. REFERENCES

1. ASTM Standard D6916, 2006c (Reapproved 2011), “Standard Test Method for Determining the Shear Strength Between Segmental Concrete Units (Modular Concrete Block)”, www.astm.org.
2. Oregon DOT Standard Specification for Construction, 2018, <https://www.oregon.gov/ODOT>
3. ICC-ES AC276, *Acceptance Criteria for Segmental Retaining Walls*, 2004, ICC Evaluation Service, LLC, www.icc-es.org.
4. *NCMA Design Manual for Segmental Retaining Walls, Third Edition*, 2009, National Concrete Masonry Association, www.ncma.org



APPENDIX A- “MURATA” UNIT SHEAR STRENGTH

Shear Strength Test Murata
Segmental Retaining Wall Units - Murata
Geosynthetic - No Grid

NCMA Job Number 18-110-3A

Test Series Number	Shear Interface Width (ft)	Average Axial Load (lb)	Average Axial Load (lb/ft)	Approximate Wall Height Corresponding to Applied Axial Load (ft)	Shear Load at Service State Deformation ¹ (lb)	Service State Shear Strength (lb/ft)	Service State Displacement (in.)	Peak Shear Load (lb)	Peak Shear Strength (lb/ft)	Peak Displacement (in.)
1	1.3	480	360	4.0	640	492	0.16	970	746	0.28
2	1.3	970	728	8.1	1240	954	0.11	1240	954	0.11
3	1.3	720	540	6.0	1110	854	0.15	1110	854	0.15
4	1.3	970	728	8.1	1210	931	0.14	1210	931	0.14
5	1.3	1210	908	10.1	1500	1154	0.16	1520	1169	0.16
6	1.3	970	728	8.1	820	631	0.16	1270	977	0.52
7	1.3	1450	1088	12.1	1640	1262	0.11	1640	1262	0.11

¹ - Service State Shear Strength defined as the shear strength at 0.16 in. displacement as required by ICC-ES AC276 (Ref. 3)

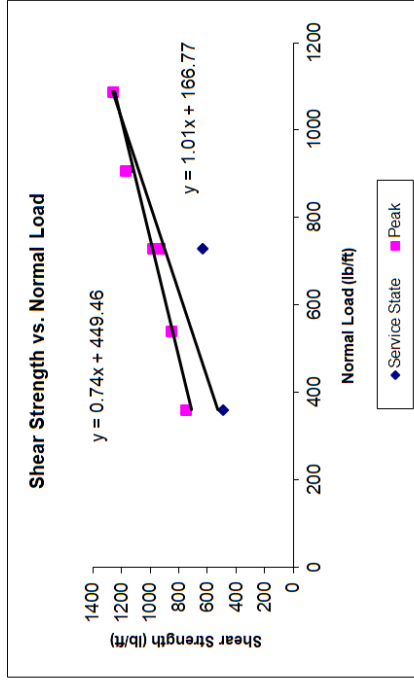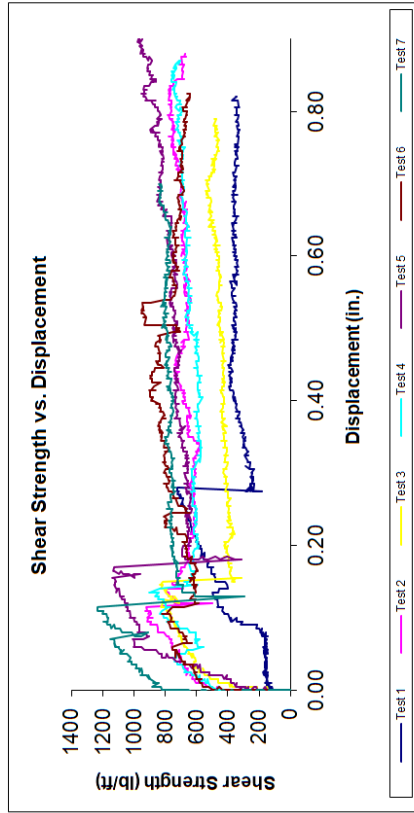



The following relationships are not required by D6916-06c (2011), but are provided for reference. Using best fit linear trend lines, the following relationships have been determined using the methodology found in the NCMA Design Manual for Segmental Retaining Walls (Ref. 4):

Peak Shear Strength, V_u (lb/ft) = Normal Load * $\tan 36.5^\circ + 449.46$ lb/ft
 Service State Shear Strength, V_u (lb/ft) = Normal Load * $\tan 45.28^\circ + 166.77$ lb/ft

Shear Strength Test Murata
Segmental Retaining Wall Units - Murata
Geosynthetic - No Grid

Test Series Number	Shear Interface Width (m)	Average Axial Load (kN)	Average Axial Load (kN/m)	Approximate Wall Height Corresponding to Applied Axial Load (m)	Shear Load at Service State (kN)	Service Shear Strength (kN/m)	Service State Displacement (mm)	Peak Shear Load (kN)	Peak Shear Strength (kN/m)	Peak Displacement (mm)
1	0.40	2.1	5.4	1.22	2.8	7.2	3.94	4.3	10.9	7.0
2	0.40	4.3	10.9	2.46	5.5	13.9	2.79	5.5	13.9	2.8
3	0.40	3.2	8.1	1.83	4.9	12.5	3.68	4.9	12.5	3.7
4	0.40	4.3	10.9	2.46	5.4	13.6	3.43	5.4	13.6	3.4
5	0.40	5.4	13.6	3.07	6.7	16.8	3.94	6.8	17.1	3.9
6	0.40	4.3	10.9	2.46	3.6	9.2	3.94	5.7	14.3	13.2
7	0.40	6.5	16.3	3.68	7.3	18.4	2.79	7.3	18.4	2.8

¹ - Service State Shear Strength defined as the shear strength at 4.1 mm displacement as required by ICC-ES AC208 (Ref. 3)

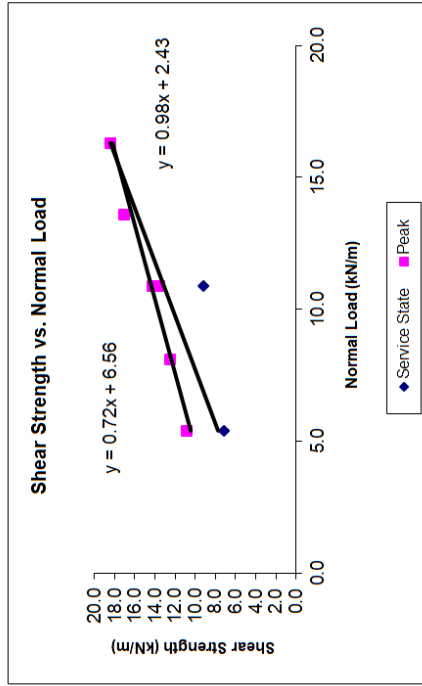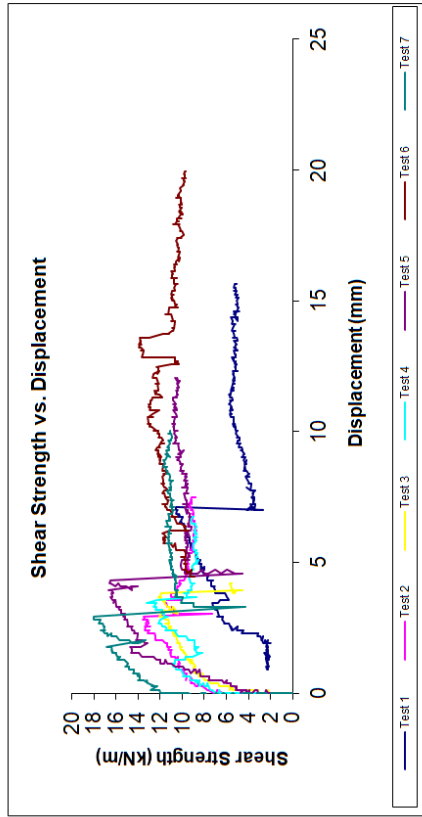

The following relationships are not required by D6916-06c (2011), but are provided for reference. Using best fit linear trend lines, the following relationships have been determined using the methodology found in the NCMA Design Manual for Segmental Retaining Walls (Ref. 4):
 Peak Shear Strength, V_u (kN/m) = Normal Load * tan 35.75° + 6.56 kN/m
 Service State Shear Strength, V_u (kN/m) = Normal Load * tan 44.42° + 2.43 kN/m